




This material and the information herein is the property of Fuji Electric (China) Co., Ltd. They shall be neither reproduced, nor used for any other purpose without the express written consent of Fuji Electric (China) Co., Ltd.

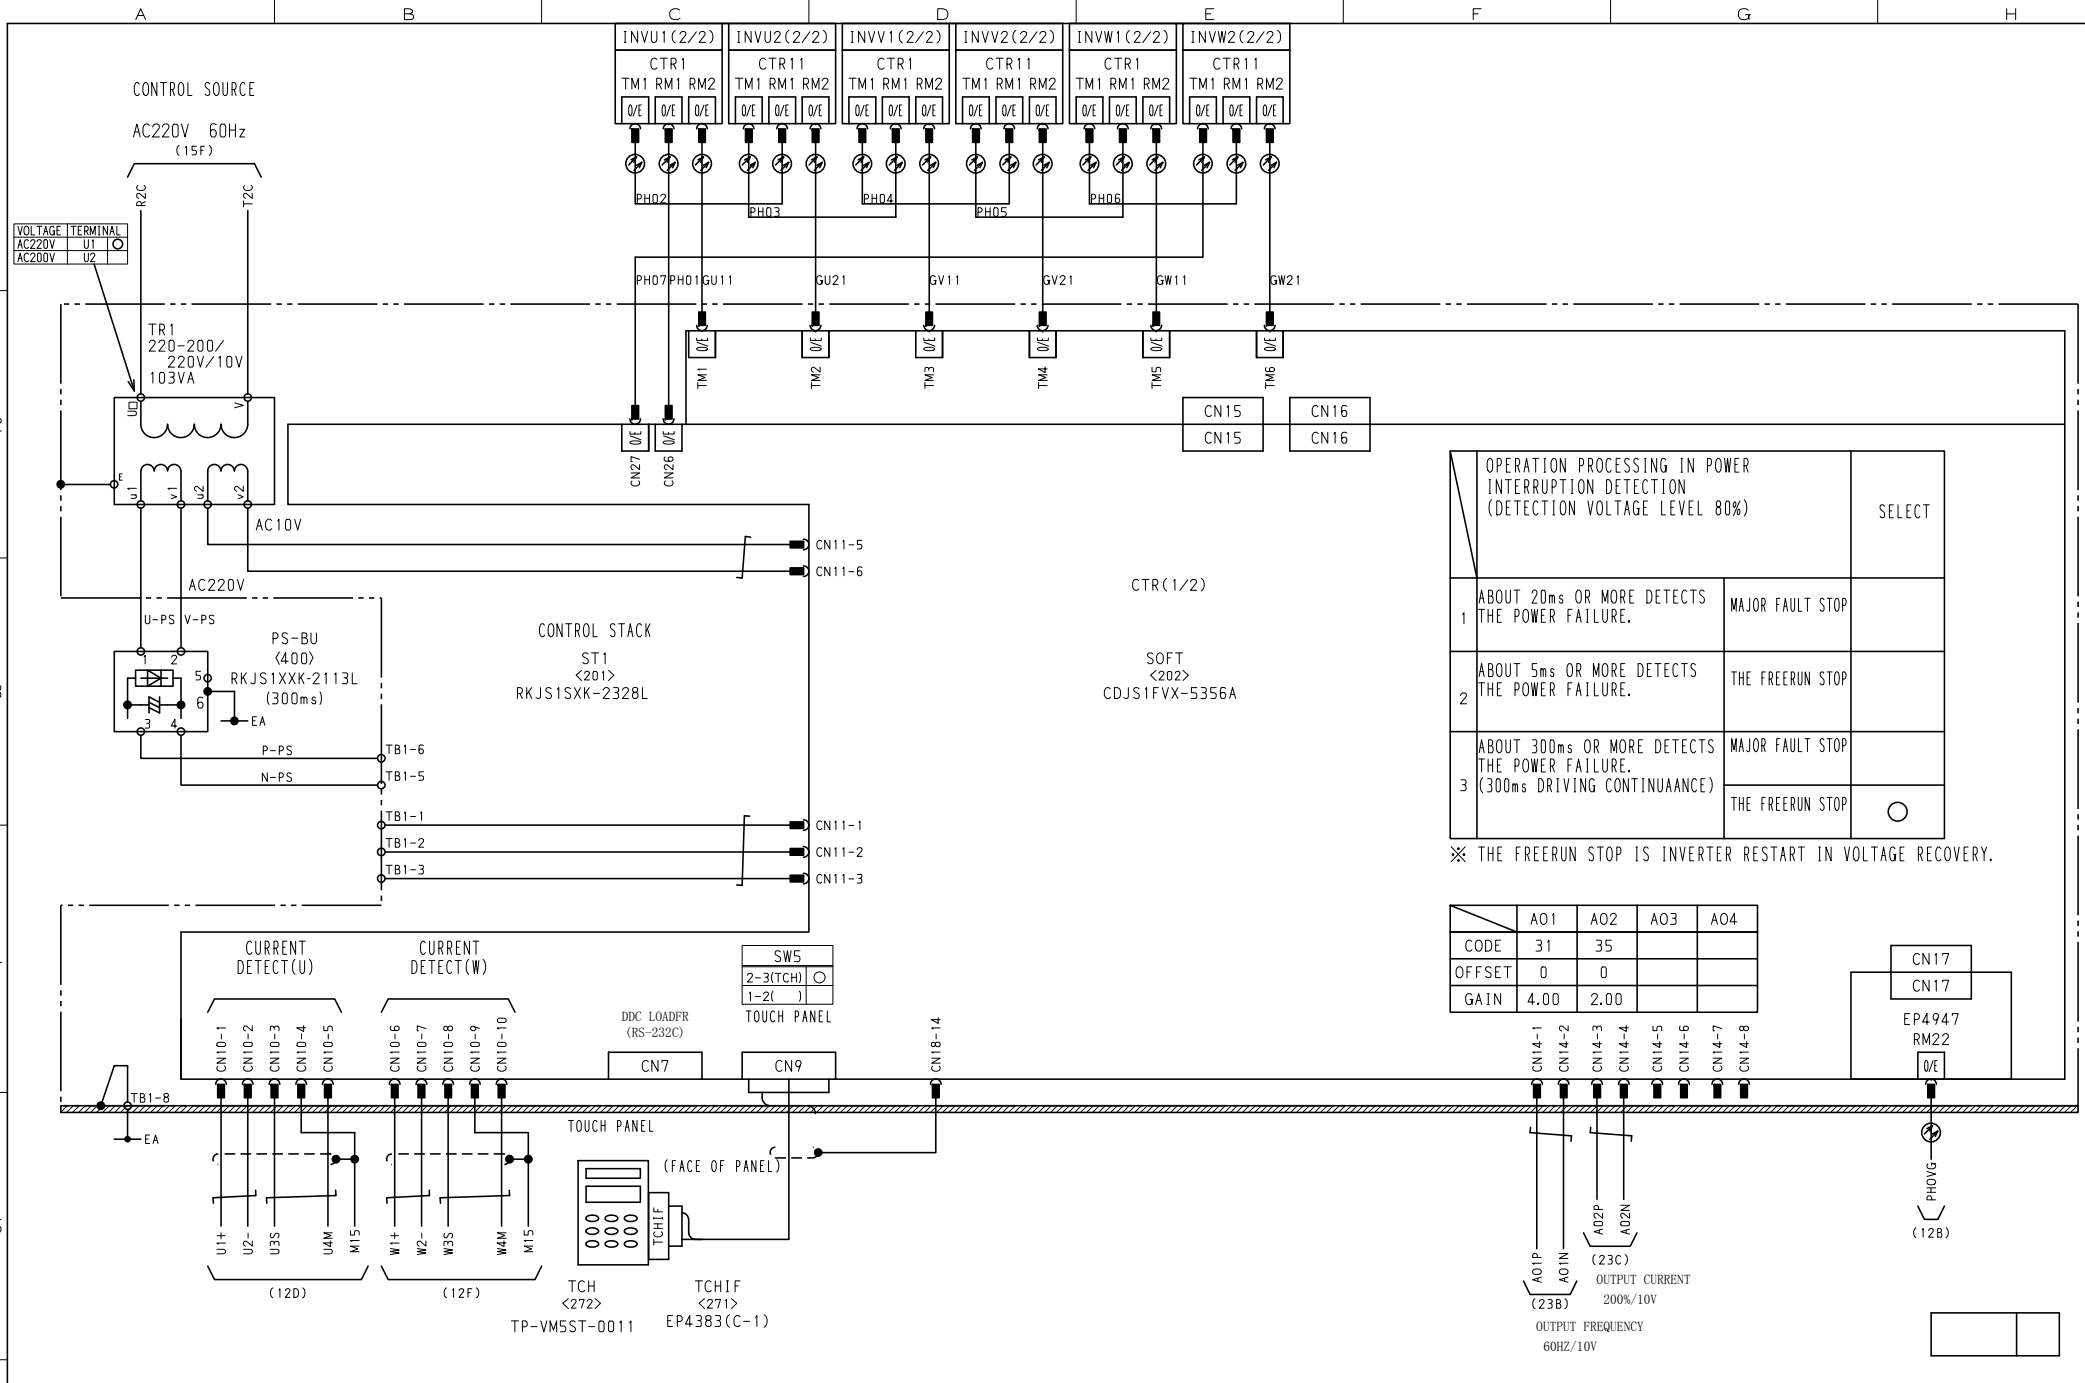

OPERATION PROCESSING IN POWER INTERRUPTION DETECTION (DETECTION VOLTAGE LEVEL 80%)		SELECT
1	ABOUT 20ms OR MORE DETECTS THE POWER FAILURE.	MAJOR FAULT STOP
2	ABOUT 5ms OR MORE DETECTS THE POWER FAILURE.	THE FREERUN STOP
3	ABOUT 300ms OR MORE DETECTS THE POWER FAILURE. (300ms DRIVING CONTINUANCE)	MAJOR FAULT STOP
		THE FREERUN STOP

※ THE FREERUN STOP IS INVERTER RESTART IN VOLTAGE RECOVERY.

	A01	A02	A03	A04
CODE	31	35		
OFFSET	0	0		
GAIN	4.00	2.00		

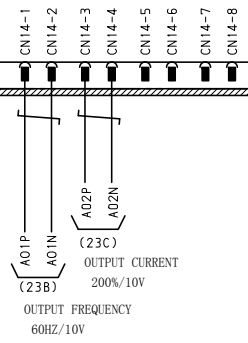

Revisions	Date	Name	Approved
	Drawn 2014-07-17	W. ZHAN/Z. Z	
	Checked 2014-07-17	Z. HUA	
Fuji Electric (China) Co., Ltd.			

Title	INVERTER CUBICLE CONTROL STACK	
	Ref. Drawing No.	WMS54038
		20
HF 15-053-BP021500043		20

11#0907B
15#07#200B